

EAST DURHAM WIND ENERGY CENTRE

Noise Assessment Report Summary

OCTOBER 2012

East Durham Wind, Inc., a wholly owned subsidiary of NextEra Energy Canada, ULC (NextEra), is proposing to construct a wind energy project in the Municipality of West Grey, Grey County, Ontario. The Project will be referred to as the East Durham Wind Energy Centre (the “Project”) and will be located on private lands east of the Community of Durham and west of the Village of Priceville. The wind turbine technology proposed for this Project is the GE 1.6-100 model wind turbine. With a total maximum nameplate capacity of up to 23 MW, the Project is categorized as a Class 4 facility. The project consists of up to 16 GE model wind turbines with 14 turbines that are 1.6-100 (1.62 MW), Turbine 6 is 1.34-100 (1.34 MW) and Turbine 2 is 1.39-100 (1.39 MW). Although NextEra is seeking a Renewable Energy Approval (REA) for up to 16 wind turbines, only 14 will be constructed for the project.

The purpose of the Noise Assessment Report is to ensure that sound produced from the operating wind turbines and the transformer substations remain within Provincial guidelines for Points of Reception (Points of Reception are defined on page 2).

The Noise Assessment Report was prepared in accordance with the requirements outlined in Ontario Regulation 359/09, the regulation governing renewable energy projects in Ontario in addition to the Ministry of the Environment’s “Noise Guidelines for Wind Farms”.

Corresponding section references are provided below to assist with reviewing the associated reports.



EAST DURHAM WIND ENERGY CENTRE

Noise Assessment Report Summary

STUDY PROCESS

According to Ontario Regulation 359/09, the regulation governing renewable energy approvals in the Province, turbines must be sited 550 metres (m) from non-participating Points of Reception. In addition, sound levels at non-participating points of reception cannot exceed 40 decibels (dBA) once the turbines and transformer substation are in operation. The Ministry of the Environment (MOE) also requires that the sound effects from existing wind turbines are included in the analysis. There are no wind farms located within 5 kilometres of the East Durham Wind Energy Centre.

POINTS OF RECEPTION - SECTION 5

A Point of Reception, or noise receptor, is a location on a property where someone may be impacted by sound. Points of Reception include buildings used for overnight stay, such as houses or apartments, in addition to schools, day care centres, churches and, within 30 metres of a dwelling or camp area. Note that the noise analysis also considers potential Points of Reception on vacant lands where there are currently no buildings or structures. These are referred to as Vacant Lot Points of Reception.

The following table describes the number and type of Points of Reception that were included in the noise analysis and whether MOE limits apply.

Number of Points of Reception	Description	Remarks
165	Non-participating	MOE Limits Apply
12	Participating	MOE Limits Do Not Apply
56	Vacant Lot Non-participating	MOE Limits Apply
3	Vacant Lot Participating	MOE Limits Do Not Apply



EAST DURHAM WIND ENERGY CENTRE

Noise Assessment Report Summary

Any Point of Reception classified as non-participating is subject to noise level limits outlined in the MOE guidelines. Participating Points of Reception are not subject to noise level limits because the parcels of land host infrastructure associated with the Project.

RESULTS - SECTION 8


After modelling predicted noise levels from the proposed turbine and transformer substation, it was concluded that:

- All Non-Participating Points of Reception comply with MOE guidelines for wind turbines, meaning that they are predicted to be below the 40 dBA noise threshold and are greater than 550 m from the nearest wind turbine.
- All Non-Participating Vacant Lot Points of Reception comply with MOE guidelines for wind turbines, meaning that they are predicted to be below the 40 dBA noise threshold and are greater than 550 m from the nearest wind turbine.
- All Points of Reception comply with MOE guidelines for the transformer substation.



EAST DURHAM WIND ENERGY CENTRE

Noise Assessment Report Summary

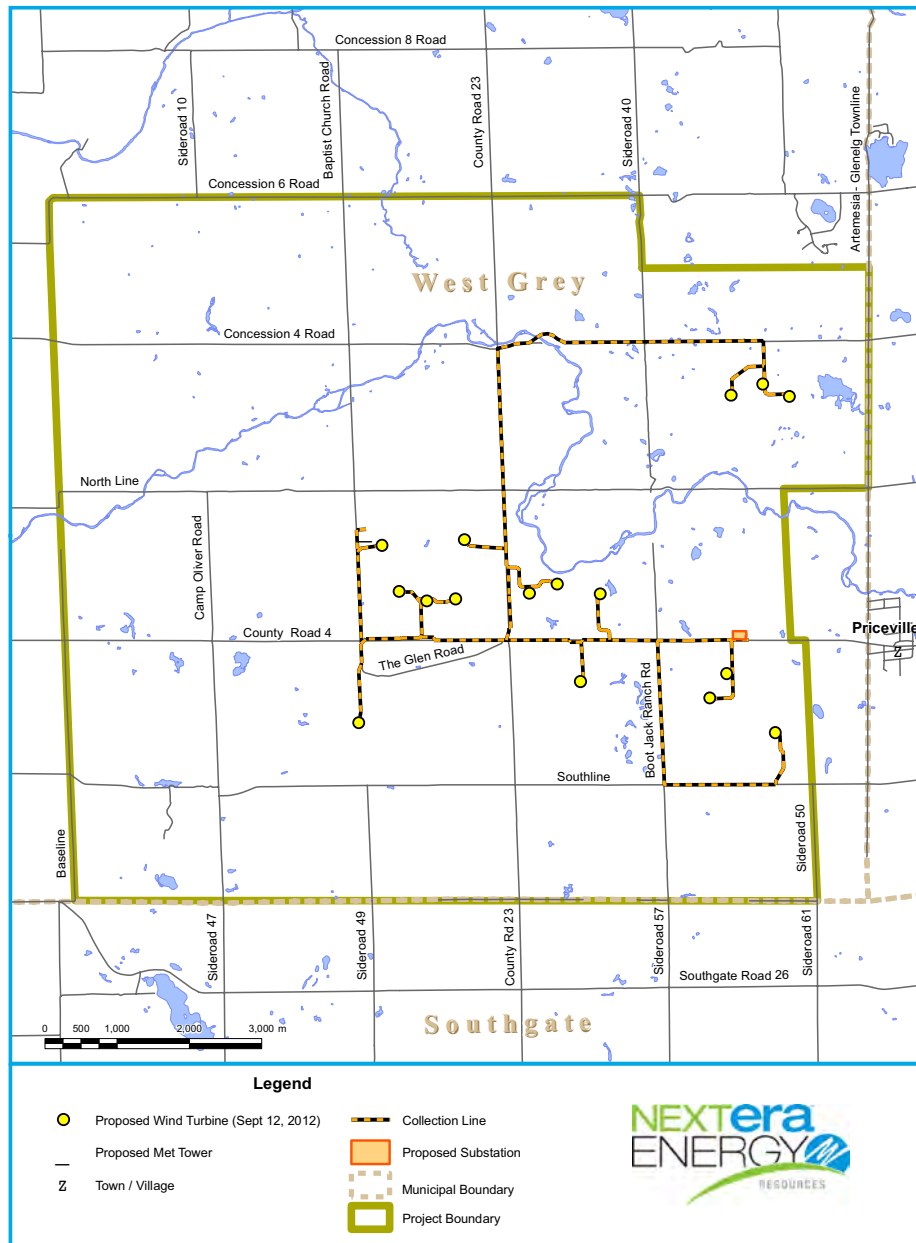

Have A Question?

We hope you find this Plain Language Summary helpful. In case you would like additional information or have any questions, please contact us directly:

Project Proponent

Derek Dudek

Community Relations Consultant

NextEra Energy Canada, ULC

390 Bay St, Suite 1720

Toronto, Ontario, M5H 2Y2

Phone: 1-877-257-7330

Email: EastDurham.Wind@NextEraEnergy.com

Project Consultant

Patricia Becker, MES

Project Manager (Energy)

GENIVAR Inc.

5th Floor, 600 Cochrane Drive

Markham, Ontario, L3R 5K3

Phone: 905-713-2837

Email: pat.becker@genivar.com